

CURB BOX TO BE FLUSH WITH FINISH GRADE AND PROVIDED WITH A BOLT LOCKABLE COVER MARKED WITH WORD "WATER" FORMED IN LID.


CURB BOX AND CURB STOP TO BE LOCATED AT P OR R/W UNLESS SHOWN OTHERWISE.

FINISH GRADE

"BIBBY"-S7E-, CROIX FOUNDRIES, INC.  
FIGURE NO. 94E, SHAFT SCREW SERVICE BOX

NOTE:  
PROVIDE A LOOP WITH SUFFICIENT SLACK TO PREVENT SERVICE LINE FROM BUCKING OR PULLING OUT OF CORPORATION STOP DURING BACKFILLING AND SETTLING OF TRENCH.

42" MINIMUM

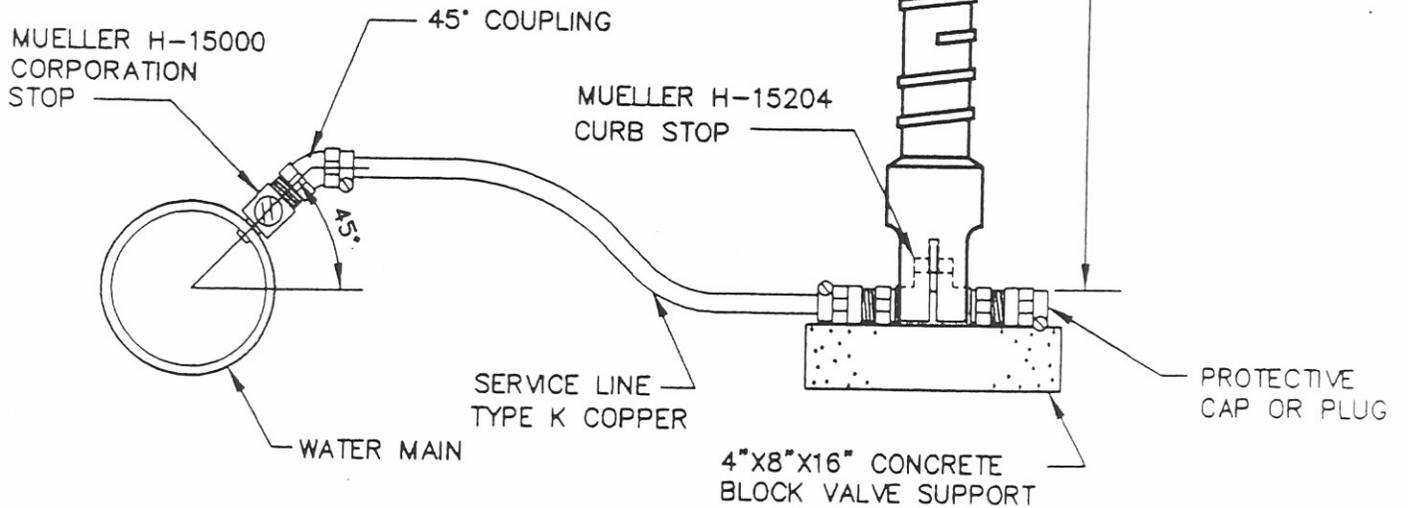

CITY OF NEW PHILADELPHIA

TYPICAL SERVICE LINE  
AND SERVICE STOP SETTING

STANDARD  
CONSTRUCTION  
DRAWING NO.

SD-139

REV. 11-92